



Legend:



Note:

- Minimum flow rate through the heating circuit must be ensured at all times (use of individual room controls and actuators is limited)
- Observe the maximum draw-off capacity of the domestic hot water system
- Provide at least 500 l volume for domestic hot water
- Do not use automatic air vents or safety valves in the building (safety valve is located in the unit)
- Observe the dew point during active cooling
- NOT suitable for radiators

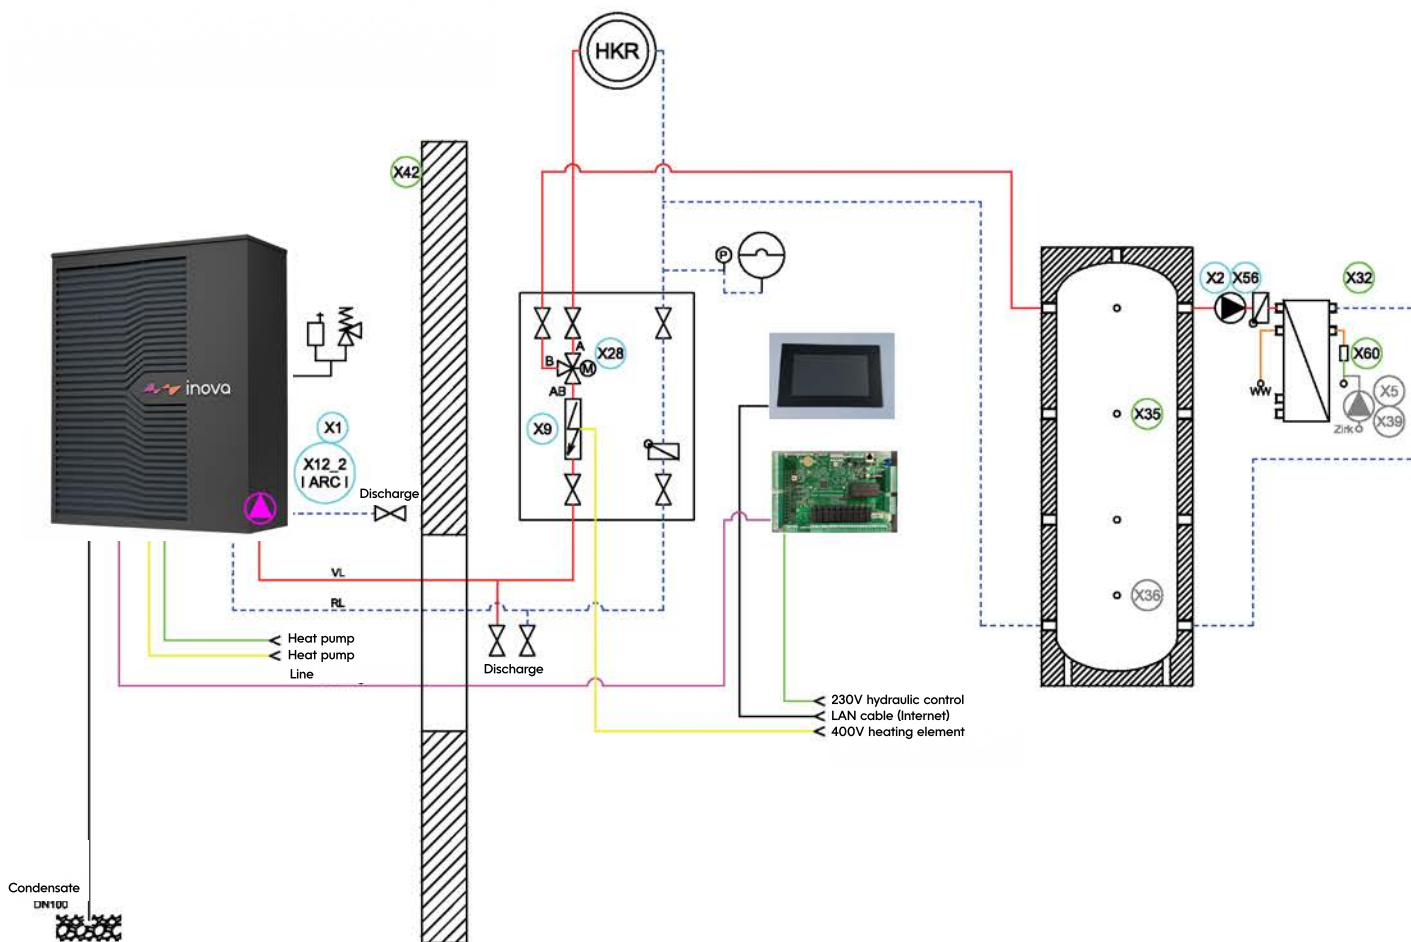

No guarantee of accuracy. This drawing represents a schematic diagram and may differ from actual practice. Reproduction is permitted only with written consent.

Designation:  
Direct circuit with freshwater system

Date: 24.02.2026

Name: Inova