Legend:

Pump: Shut-off valve: Mixer:

Check valve: USV: ADG:

Note:

- Minimum flow through the heating circuit must be ensured at all times (use of individual room controls and actuators is limited).
- Provide a buffer volume of at least 500 l for domestic hot water
- Observe the storage tank's draw-off capacity at low storage temperatures (50°C).
- Do not use automatic air vents or safety valves in the building (safety valve is located in the unit)
- Observe the dew point during active cooling
- NOT suitable for radiators

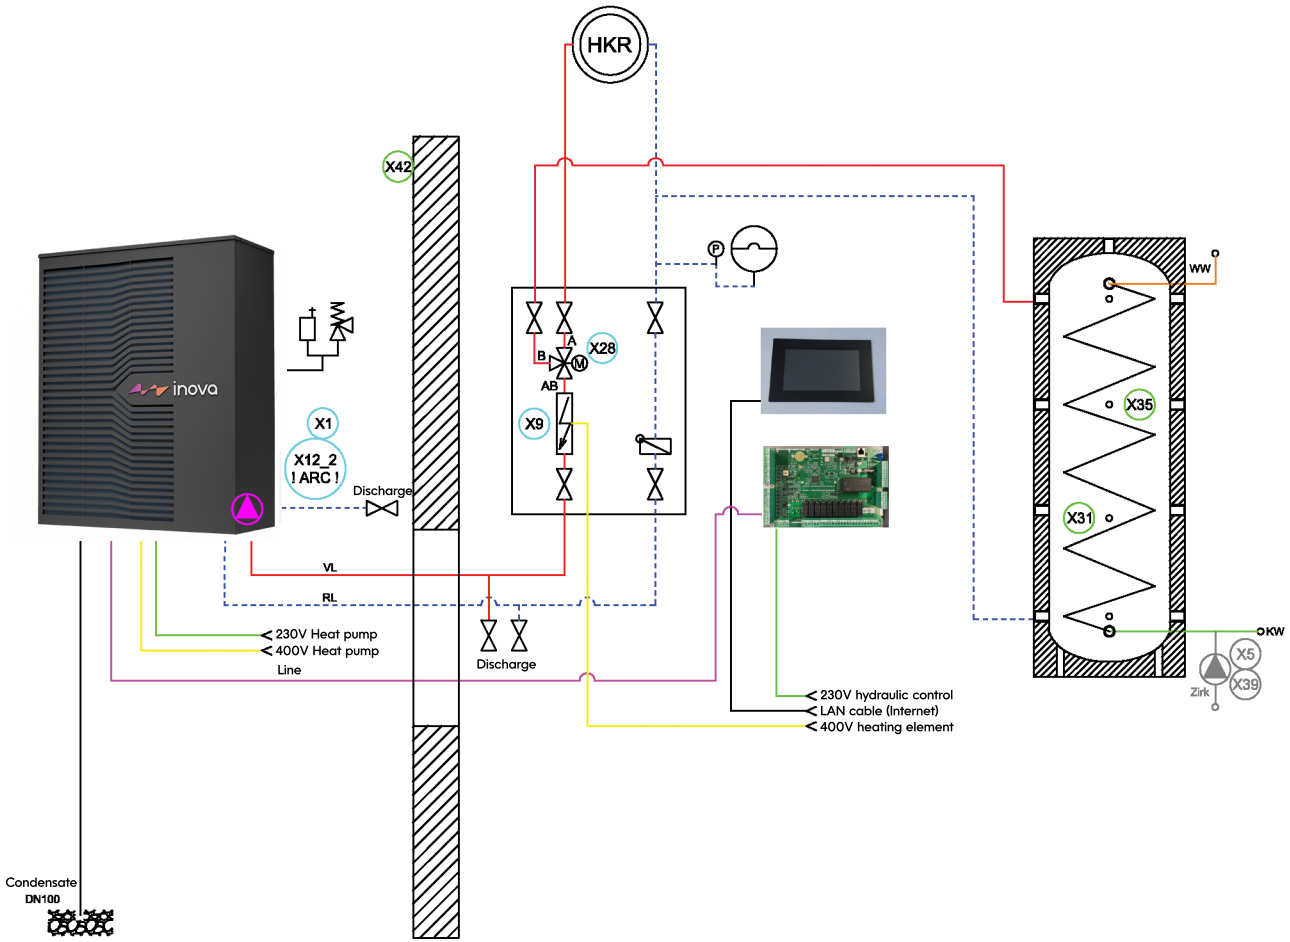

No guarantee of accuracy. This drawing represents a schematic diagram and may differ from actual practice.
Reproduction is permitted only with written consent.

Designation:
Direct circuit with hygienic reservoir

Date:	24.02.2026
Name:	Inova