



Legend:



Note:

- Observe the maximum draw-off capacity of the domestic hot water system
- Provide a buffer volume of at least 500 l for domestic hot water
- Provide a buffer volume of at least 2 x 4.6 l/kW nominal output for heating
- Do not use automatic air vents or safety valves in the building (safety valve is located in the unit)
- Observe the dew point during active cooling

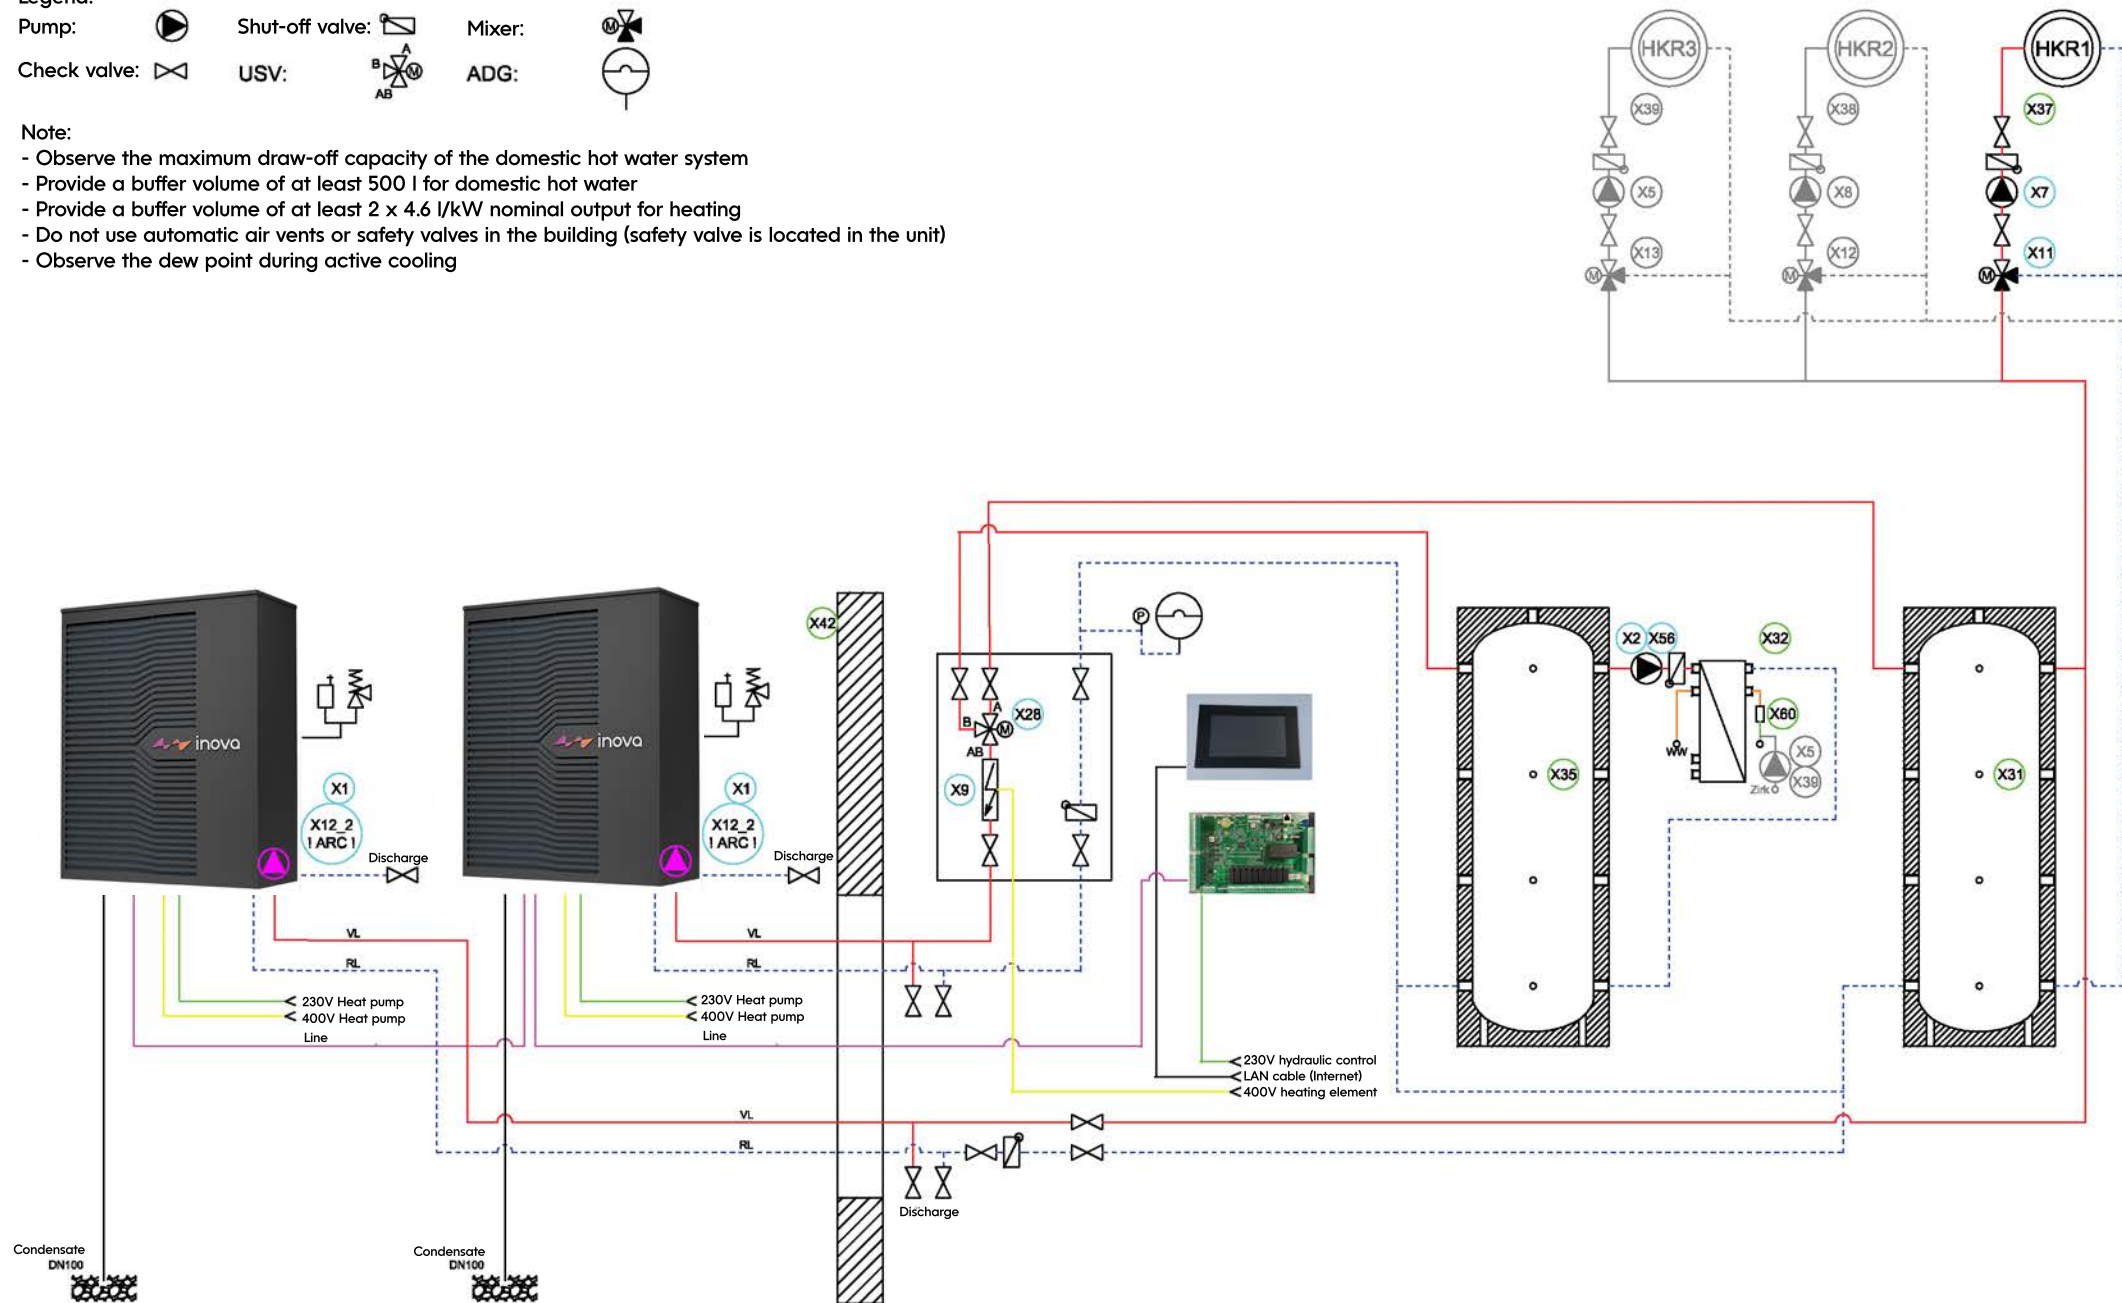

No guarantee of accuracy. This drawing represents a schematic diagram and may differ from actual practice. Reproduction is permitted only with written consent.

Designation:
Dual storage solution with fresh water system and 2-unit cascade

| | |
|-------|------------|
| Date: | 24.02.2026 |
| Name: | Inova |